

Duraclad® Type MC THHN/THWN Copper Conductor Feeder Cable 277/480 Colors

Copper THHN/THWN-2 Insulated Singles. Green or Bare Copper Grounding Conductor. UL Listed 600 Volts. Rated VW-1. Lightweight Galvanized Steel Interlocked Armor.

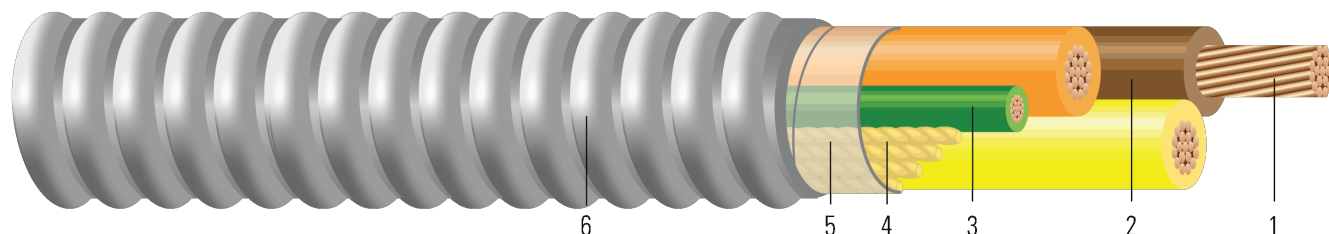


Image not to scale. See Table 1 for dimensions.

CONSTRUCTION:

1. **Conductor:** Class B compressed copper per ASTM B3 and ASTM B8
2. **Insulation:** All phases are insulated with Polyvinyl Chloride with Nylon Sheath Type THHN/THWN
3. **Ground:** Green insulated or bare stranded copper ground
4. **Filler:** Fillers as needed
5. **Binder:** Mylar tape
6. **Armor:** Galvanized Steel Interlocked Armor

APPLICATIONS AND FEATURES:

Southwire Armorlite® Type MC Feeder Cable is suitable for use as follows:

- Feeder and service power distribution in commercial, industrial, institutional, and multi-residential buildings.
- Fished or embedded in plaster.
- Concealed or exposed installations.
- Environmental air-handling spaces per NEC 300.22 (C).
- Places of Assembly per NEC 518.4 and theaters per NEC 520.5.
- Installation in cable tray and approved raceways.
- Under raised floors for information technology equipment conductors and cables per NEC 645.5(D) & 645.5(D)(2)
- Class I Div. 2, Class II Div 2, & Class III Div. 1 Hazardous Locations.
- Binder tape with print legend wrapped around assembly.
- Type THHN/THWN rated 90°C Dry.

Southwire Duralclad® Type MC Cable - meets or exceeds the following requirements:

- UL Online Product Guide Info - Metal-Clad Cable (PJAZ) (www.ul.com)
- Federal Specification A-A59544 (formerly J-C-30B)
- NFPA 70 (National Electrical Code), Article 330
- Listed for use in UL 1, 2 and 3 Hour Through Penetration Firestop Systems

Color Code

- 3/C: Brown, Orange, Yellow
- 4/C: Brown, Orange, Yellow, Gray



Southwire Company, LLC | One Southwire Drive, Carrollton, GA 30119 | www.southwire.com

Copyright © 2024 Southwire Company, LLC. All Rights Reserved



Southwire

**CABLETECH
SUPPORT™**

Services

UPDATED: Feb. 2, 2024, 1:35 p.m. UTC REVISION: 1.000.004

SPECIFICATIONS:

- ASTM B3 Soft or Annealed Copper Wire
- ASTM B8 Concentric-Lay-Stranded Copper Conductors
- UL 83 Thermoplastic Insulated Wires and Cables
- UL 1569 Metal-Clad Cables
- UL 1479 Standard for Safety Fire Tests of Penetration Firestops
- UL 1685 FT4 Vertical-Tray Fire Propagation and Smoke Release Test
- IEEE 1202 FT4 Flame Test (70,000) BTU/hr Vertical Tray Test
- RoHS-2 (European Directive 2011/65/EU)
- Buy American: Compliant with Buy American Requirements, found in 49 U.S.C. § 5323(j); specify "Made in the USA Only!" when ordering to ensure your project receives American made products.

SAMPLE PRINT LEGEND:

E96627 {UL} TYPE MC AWG XX THHN OR THWN CDRS FOR USE IN CABLE TRAYS 600 VOLTS

Table 1 – Weights and Measurements

Stock Number	Cond. Size	Conductor Number	Color	Diameter Over Conductor	Conductor Stranding	Insulation Thickness	Ground Size	Diameter Over Armor	Copper Weight	Overall Weight
	AWG/ Kcmil			inch		mils	No. x AWG	inch	lbs/1000ft	lbs/1000ft
665920	3/0	3	BN/OE/ YW	0.456	19	50	1x4 GG	1.506	1699	2369
677966	4/0	3	BN/OE/ YW	0.512	19	60	1x4 GG	1.543	2109	2908
678473	400	3	BN/OE/ YW	0.705	37	60	1x1/0 GG	2.168	4071	5054
677968◊	600	3	BN/OE/ YW	0.865	61	80	1x1/0 GG	2.395	5942	7285

All dimensions are nominal and subject to normal manufacturing tolerances

◊ Cable marked with this symbol is a standard stock item

Note: Conductor number = number of phase conductors. Does not include ground

Note: GG = Green insulated ground

Table 2 – Electrical and Engineering Data

Cond. Size	Conductor Number	Min. Bend Radius	Max Pull Tension	DC Resistance at 25°C	AC Resistance at 75°C	Inductive Reactance @ 60Hz	Allowable Ampacity Raceway 60°C	Allowable Ampacity Raceway 75°C	Allowable Ampacity Raceway 90°C
AWG/ Kcmil		Inches	Lbs	Ω/1000ft	Ω/1000ft	Ω/1000ft	Amp	Amp	Amp
3/0	3	10.5	4027	0.064	0.078	0.042	165	200	225
4/0	3	10.8	5078	0.051	0.062	0.041	195	230	260
400	3	15.2	9600	0.027	0.035	0.04	280	335	380
600	3	16.8	14400	0.018	0.025	0.039	350	420	475

* Ampacities based upon 2023 NEC Table 310.16. See NEC sections 310.15 and 110.14(C) for additional requirements.

