

# TCU 2000V XLPE Insulation Three Grounds Cu Tape Shield PVC Jacket. RHH/RHW-2 Flexible Variable Frequency Drive (VFD)

Type TC-ER VFD Power Cable. 2000 Volt Tinned Copper Flexible Stranded Conductors. Cross-Linked Polyethylene (XLPE) Insulation RHH/RHW-2. Polyvinylchloride (PVC) Jacket with 3 Symmetrical Grounds. Rated 90°C Wet or Dry, FT4 Flame.

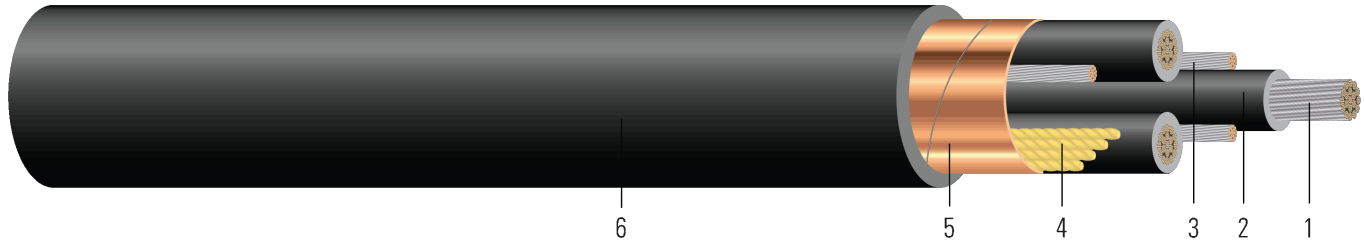


Image not to scale. See Table 1 for dimensions.

## CONSTRUCTION:

- Conductor:** Class Class I flexible ropelay stranded tinned copper per ASTM B33 and B172.
- Insulation:** Cross-Linked Polyethylene (XLPE); Type RHH/RHW-2
- Grounding Conductor:** : 3 Flexible Ropelay Stranded Tinned Copper Grounds per ASTM B33 and B172
- Filler:** Flame & Moisture Resistant Paper Filler
- Tape Shield:** 5 mil Copper Tape Shield with a minimum of 50% Overlap for 100% Coverage
- Overall Jacket:** Black Polyvinyl Chloride (PVC) Jacket

## APPLICATIONS AND FEATURES:

Southwire's 2000 Volt Type TC-ER VFD power cables are suited for use in wet and dry areas, conduits, ducts, troughs, trays, direct burial, aerial supported by a messenger, and where superior electrical properties are desired. These cables are capable of operating continuously at the conductor temperature not in excess of 90°C for normal operation in wet and dry locations, 130°C for emergency overload, and 250°C for short circuit conditions. For uses in Class I, II, and III, Division 2 hazardous locations per NEC® Article 501 and 502. Constructions with 3 or more conductors are listed for exposed runs (TC-ER) per NEC® Article 336.10.

## SPECIFICATIONS:

- ASTM B33 Standard Specification for Tin-Coated Soft or Annealed Copper Wire
- ASTM B172 Standard Specification for Rope-Lay-Stranded Copper Conductors Having Bunch-Stranded Copper Conductors (As Applicable)
- UL 44 Thermoset-Insulated Wires and Cables
- UL 1277 TC-ER
- UL 1685 FT4 Vertical-Tray Fire Propagation and Smoke Release Test
- ICEA S-58-679 Control Cable Conductor Identification Method 4
- ICEA S-95-658 (NEMA WC70) Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy
- IEEE 1202 FT4 Flame Test (70,000) BTU/hr Vertical Tray Test

## SAMPLE PRINT LEGEND:

{SQFTG} SOUTHWIRE{R} VFD {UL} [#AWG or #KCMIL] 3/C TYPE TC-ER RHH OR RHW-2 CDRS CU GW 3 X # AWG CU T/ S50% 90{D}C PVC JACKET SUN RES DIRECT BURIAL FT4/IEEE1202 2000 VOLTS



Southwire

**CABLETECH  
SUPPORT™**

Services

**Table 1 – Weights and Measurements**

Cond. Size	Cond. Number	Strand Count	Diameter Over Conductor	Insul. Thickness	Ground	Dia. Over Shield	Jacket Thickness	Approx. OD	Copper Weight	Approx. Weight
AWG/Kcmil		No. of Strands	inch	mil	No. x AWG	inch	mil	inch	lb/1000ft	lb/1000ft
2	3	168	0.290	70	3 x 10	0.964	80	1.124	592	1017

All dimensions are nominal and subject to normal manufacturing tolerances

◊ Cable marked with this symbol is a standard stock item

**Table 2 – Electrical and Engineering Data**

Cond. Size	Cond. Number	Min Bending Radius	Max Pull Tension	DC Resistance @ 25°C	AC Resistance @ 75°C	Capacitive Reactance @ 60Hz	Inductive Reactance @ 60Hz	Allowable Ampacity At 60°C	Allowable Ampacity At 75°C	Allowable Ampacity At 90°C
AWG/Kcmil		inch	lb	Ω/1000ft	Ω/1000ft	MΩ/1000ft	Ω/1000ft	Amp	Amp	Amp
2	3	13.5	1592	0.172	0.207	0.027	0.045	95	115	130

\* Ampacities based upon 2023 NEC Table 310.16. See NEC sections 310.15 and 110.14(C) for additional requirements.

