# Armorlite® Type MC XHHW-2 PVC Jacketed Aluminum Conductor Feeder Cable. Rated 600 or 1000 Volts. Silicone Free

Aluminum XHHW-2 Insulated Singles with 8000 Series Triple E™ Aluminum Alloy. Bare AlumaFlex™ Aluminum Alloy Grounding Conductor. UL Listed. 600 or 1000 Volts. Rated VW-1. Lightweight Aluminum Interlocked Armor with Overall PVC Jacket Sunlight Resistant.

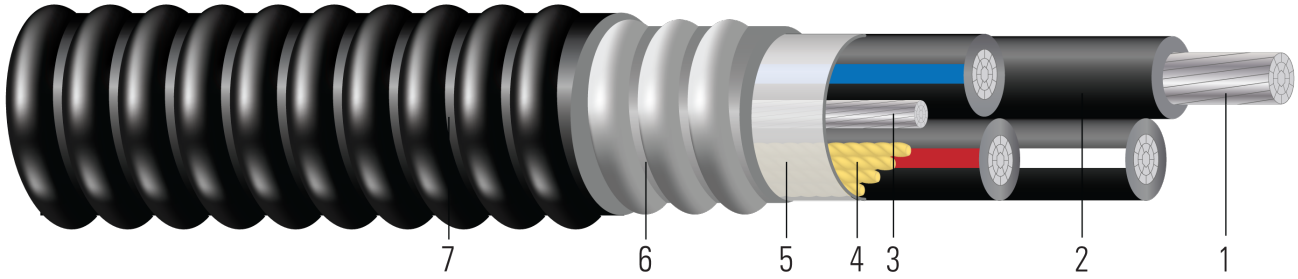



Image not to scale. See Table 1 for dimensions.

## CONSTRUCTION:

1. **Conductor:** Class B compact stranded 8000 Series aluminum per ASTM B800 and ASTM B801
2. **Insulation:** All phases are insulated with Cross Linked Polyethylene (XLPE) Type XHHW-2
3. **Ground:** Bare aluminum ground
4. **Filler:** Fillers as needed
5. **Binder:** Mylar tape
6. **Armor:** Aluminum Interlocked Armor
7. **Jacket:** Polyvinyl Chloride (PVC) sunlight resistant, and corrosion resistant

## APPLICATIONS AND FEATURES:

**Southwire Armorlite® Type MC Feeder cable is suitable for use as follows:**

- Branch, feeder and service power distribution in commercial, industrial, institutional, and multi-residential buildings.
- Where exposed to cinder fills, strong chlorides, caustic alkalis, or vapors of chlorine or of hydrochloric acids.
- Fished or embedded in plaster.
- Concealed or exposed installations.
- Suitable for Wet Location per NEC 330.10(A)(11)
- Places of Assembly per NEC 518.4 and theaters per NEC 520.5.
- Installation in cable tray and approved raceways, or as aerial cable on a messenger.
- Under raised floors for information technology equipment conductors and cables per NEC 645.5(D) & 645.5(E)
- Class I Div. 2, Class II Div 2, & Class III Div. 1 Hazardous Locations.
- Type XHHW-2 rated 90ºC Dry/Wet Locations

**Southwire Armorlite® Type MC Feeder Cable - meets or exceeds the following requirements:**

- UL Online Product Guide Info - Metal-Clad Cable (PJAZ) ( www.ul.com )
- Federal Specification A-A59544 (formerly J-C-30B)
- NFPA 70 (National Electrical Code), Article 330
- Listed for use in UL 1, 2 and 3 Hour Through Penetration Firestop Systems

## SPECIFICATIONS:

- ASTM B800 8000 Series Aluminum Alloy Wire


Copyright © 2026 Southwire Company, LLC. All Rights Reserved

- ASTM B801 Concentric-Lay-Stranded Conductors of 8000 Series Aluminum Alloy
- UL 44 Thermoset-Insulated Wires and Cables
- UL 1569 Metal-Clad Cables
- UL 1479 Standard for Safety Fire Tests of Penetration Firestops
- UL 1685 FT4 Vertical-Tray Fire Propagation and Smoke Release Test
- IEEE 1202 FT4 Flame Test (70,000) BTU/hr Vertical Tray Test
- RoHS Compliant Lead-Free, Silicone-Free, Halogen Free
- Buy American: Compliant with Buy American Requirements, found in 49 U.S.C. § 5323(j); specify "Made in the USA Only!" when ordering to ensure your project receives American made products.

## SAMPLE PRINT LEGEND:

{SQFTG} SOUTHWIRE {UL} 4/C XX AWG COMPACT AL. --- {ALUMAFLEX}® AA8176 XHHW-2 CDRS GW 1 X X AWG AL TYPE MC FOR USE IN CABLE TRAYS 600V/1000V

### Table 1 – Weights and Measurements

| Stock Number | Cond. Size | Conductor Number | Color | Diameter Over Conductor | Conductor Stranding | Insulation Thickness | Ground Size | Diameter Over Armor | Jacket Thickness | Approx. OD | Overall Weight |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | AWG/ Kcmil | | | inch | | mils | No. x AWG | inch | mil | inch | lbs/ 1000ft |
| 554280◊ | 2 | 3 | BK,BK/ RD,BK/WE | 0.268 | 6 | 45 | 1x4 | 1.056 | 50 | 1.162 | 543 |

All dimensions are nominal and subject to normal manufacturing tolerances
◊ Cable marked with this symbol is a standard stock item
* Strand count meets minimum number per ASTM

### Table 2 – Electrical and Engineering Data

| Cond. Size | Conductor Number | Min. Bend Radius | Max Pull Tension | DC Resistance at 25°C | AC Resistance at 75°C | Inductive Reactance @ 60Hz | Allowable Ampacity Raceway 75°C | Allowable Ampacity Raceway 90°C |
|---|---|---|---|---|---|---|---|---|
| AWG/ Kcmil | | Inches | Lbs | Ω/1000ft | Ω/1000ft | Ω/1000ft | Amp | Amp |
| 2 | 3 | 8.1 | 1194 | 0.266 | 0.331 | 0.045 | 90 | 100 |

***** Ampacities based upon 2023 NEC Table 310.16. See NEC sections 310.15 and 110.14(C) for additional requirements.
***** Ampacities have been adjusted for more than Three Current-Carrying Conductors.


Copyright © 2026 Southwire Company, LLC. All Rights Reserved