CU 2000V XLPE Insulation Type RHH/RHW-2. 600V Type USE-2

Power Cable 2000 Volt Single Conductor Copper, Cross Linked Polyethylene (XLPE) Insulation for Type RHH/RHW-2 and 600 Volt for Type USE-2

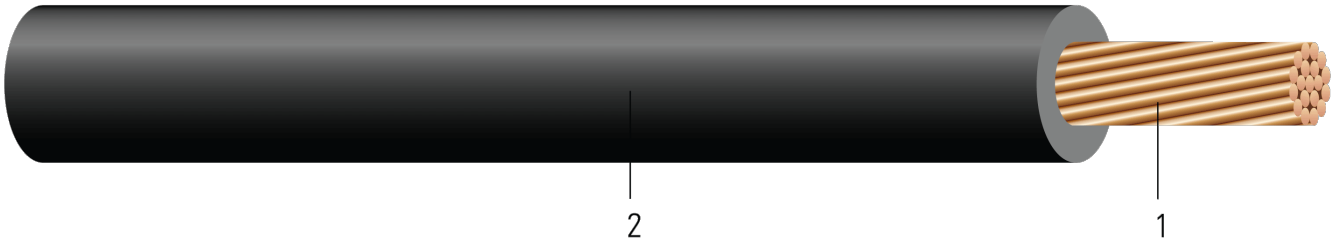


Image not to scale. See Table 1 for dimensions.

CONSTRUCTION:

1. **Conductor:** Class B compressed stranded bare copper per ASTM B3 and B8
2. **Insulation:** Cross Linked Polyethylene (XLPE) Type RHH/RHW-2

APPLICATIONS AND FEATURES:

Southwire's 2000 Volt power cables RHH/RHW are suited for use in wet and dry areas, conduits, ducts, troughs, trays, aerial supported by a messenger, and where superior electrical properties are desired. Can be used in direct burial applications at 600 Volt. These cables are capable of operating continuously at the conductor temperature not in excess of 90°C for normal operation in wet and dry locations, 130°C for emergency overload, and 250°C for short circuit conditions.

SPECIFICATIONS:

- ASTM B3 Soft or Annealed Copper Wire
- ASTM B8 Concentric-Lay-Stranded Copper Conductors
- UL 44 Thermoset-Insulated Wires and Cables
- UL 854 Service Entrance Cable
- UL 1685 Vertical-Tray Fire Propagation and Smoke Release Test
- ICEA S-95-658 (NEMA WC70) Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy

SAMPLE PRINT LEGEND:

{SQFTG} SOUTHWIRE E32071 UL} XXX KCMIL CU XXX MILS XLP 2KV TYPE RHH-RHW-2 / 600 VOLTS TYPE USE-2 90{D}C

Table 1 – Weights and Measurements

Cond. Size	Cond. Number	Strand Count	Diameter Over Conductor	Insul. Thickness	Approx. OD	Copper Weight	Approx. Weight
AWG/Kcmil		No. of Strands	inch	mil	inch	lb/1000ft	lb/1000ft
250	1	37	0.558	105	0.768	771	884

All dimensions are nominal and subject to normal manufacturing tolerances
◊ Cable marked with this symbol is a standard stock item
TBA stock codes are estimations only and actual product may vary. Please wait until a stock code is assigned to purchase connectors and/or fittings.

Table 2 – Electrical and Engineering Data

250	1	3.0	2000	0.043	0.053	0.041	255	290

***** Ampacities based upon 2023 NEC Table 310.16. See NEC sections 310.15 and 110.14(C) for additional requirements.
***** Inductive Reactance is based on non-ferrous conduit with one diameter spacing center-to-center.

Copyright © 2026 Southwire Company, LLC. All Rights Reserved