

1/C CU EPR Medium Voltage Non-Shielded Jumper & Switchgear Cable

Single Conductor Flexible Conductor with an EPR Insulation Non-Shielded Jumper Cable

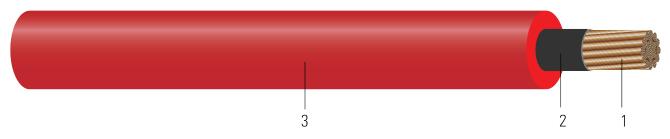


Image not to scale. See Table 1 for dimensions.

CONSTRUCTION:

- 1. **Conductor:** Flexible rope lay stranded annealed bare or tinned copper
- 2. **Conductor Shield:** Nylon semi-conducting tape, helically applied
- 3. Insulation: Heat, moisture, and ozone resistant Ethylene Propylene Rubber(EPR)

APPLICATIONS AND FEATURES:

Southwire's medium voltage non-shielded jumper and switchgear cable is a flexible power cable that is intended for use in substations installed on insulators and inside switchgear isolated from ground and where a non-shielded flexible cable is desired. These cables are capable of operating continuously at a conductor temperature not in excess of 90°C.

This cable is rated up to 40KV and is not UL listed. See Table 2 for installation guidelines

SPECIFICATIONS:

- ASTM B33 Standard Specification for Tin-Coated Soft or Annealed Copper Wire
- ASTM B172 Standard Specification for Rope-Lay-Stranded Copper Conductors Having Bunch-Stranded Copper Conductors

SAMPLE PRINT LEGEND:

SOUTHWIRE® XXX SIZE NON-SHIELDED FLEXIBLE JUMPER AND SWITCHGEAR CABLE NON-UL

Table 1 – Weights and Measurements

Cond. Size	Cond. Number	Strand Count	Diameter Over Conductor	Insul. Thickness	Approx. OD	Copper Weight	Approx. Weight
AWG/Kcmil		No. of Strands	inch	mil	inch	lb/1000ft	lb/1000ft
4/0	1	532	0.530	360	1.280	638	1244

All dimensions are nominal and subject to normal manufacturing tolerances

Table 2 – Electrical and Engineering Data

Cond. Size	Cond. Number	Max Pull Tension	DC Resistance @ 25°C	AC Resistance @ 75°C	Inductive Reactance @ 60Hz	Allowable Ampacity At 75°C	Allowable Ampacity At 90°C
AWG/ Kcmil		lb	Ω/1000ft	Ω/1000ft	Ω/1000ft	Amp	Amp
4/0	1	1692	0.055	0.067	0.041	230	260

Southwire Company, LLC | One Southwire Drive, Carrollton, GA 30119 | www.southwire.com

[♦] Cable marked with this symbol is a standard stock item

[†] Ampacities based upon 2023 NEC Table 310.16. Also, see NEC sections 310.15 and 110.14(C) for additional requirements.